



Certified Product Listing

For:

Drinking Water System Components - Health Effects

Company:

VAHN-TECH International Inc.
10-755 Queensway East
Mississauga, ON L4Y 4C5, Canada

Standards:

NSF/ANSI/CAN 61 - 2022
NSF/ANSI/CAN 372 - 2022

Certificate:

Issued Date: 01/09/2024

Material/Product:

AWWA C504 Butterfly Valve

Contact Temperature:

23 ± 2°C

Models:

VT-BFV-A04



Product certified to NSF/ANSI/CAN 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.



Certified Product Listing

For:

Drinking Water System Components - Health Effects

Company:

VAHN-TECH International Inc.
10-755 Queensway East
Mississauga, ON L4Y 4C5, Canada

Standards:

NSF/ANSI/CAN 61 - 2022
NSF/ANSI/CAN 372 - 2022

Certificate:

Issued Date: 01/09/2024

Material/Product:


AWWA C508 Rubber Disk Check Valve

Contact Temperature:

23 ± 2°C

Models:

VT-RCV

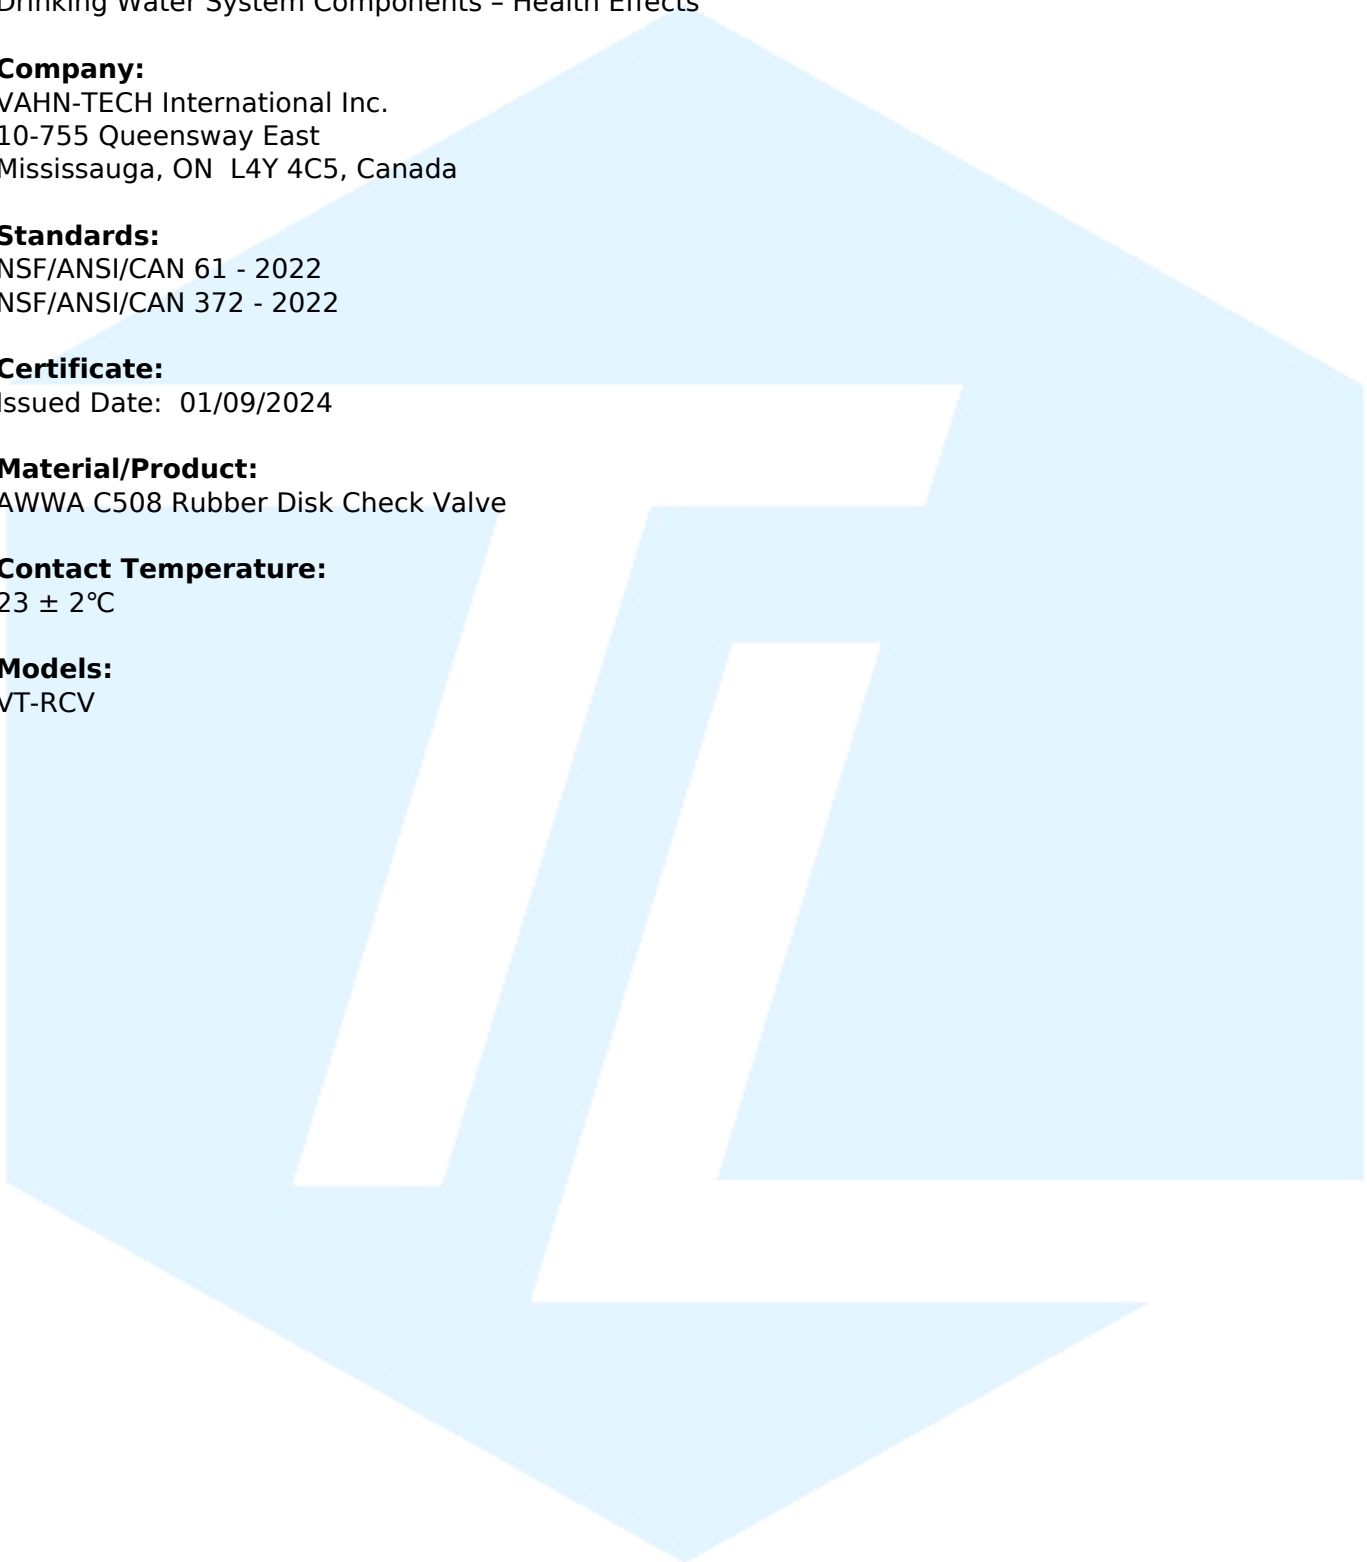

Product certified to NSF/ANSI/CAN 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.



Certified Product Listing

For:

Drinking Water System Components - Health Effects

Company:

VAHN-TECH International Inc.
10-755 Queensway East
Mississauga, ON L4Y 4C5, Canada

Standards:

NSF/ANSI/CAN 61 - 2022
NSF/ANSI/CAN 372 - 2022

Certificate:

Issued Date: 01/09/2024

Material/Product:

Silent Non-Slam Check Valve

Contact Temperature:

23 ± 2°C

Models:

VT-NSCV



Product certified to NSF/ANSI/CAN 372 conforms to the requirements for "Lead Free" plumbing products as defined by California, Vermont, Maryland and Louisiana state laws and by section 1417 of the US SDWA.